


REV	DESCRIPTION	BY	DATE	---	----	---	---/--	---	----	---	---/--
-	---/--/---	---	-/-/-	-	----	---	---/--	-	----	---	---/--

TYPICAL DISPENSER FIELD WIRING TO DM-EX MODULE AND LVDD

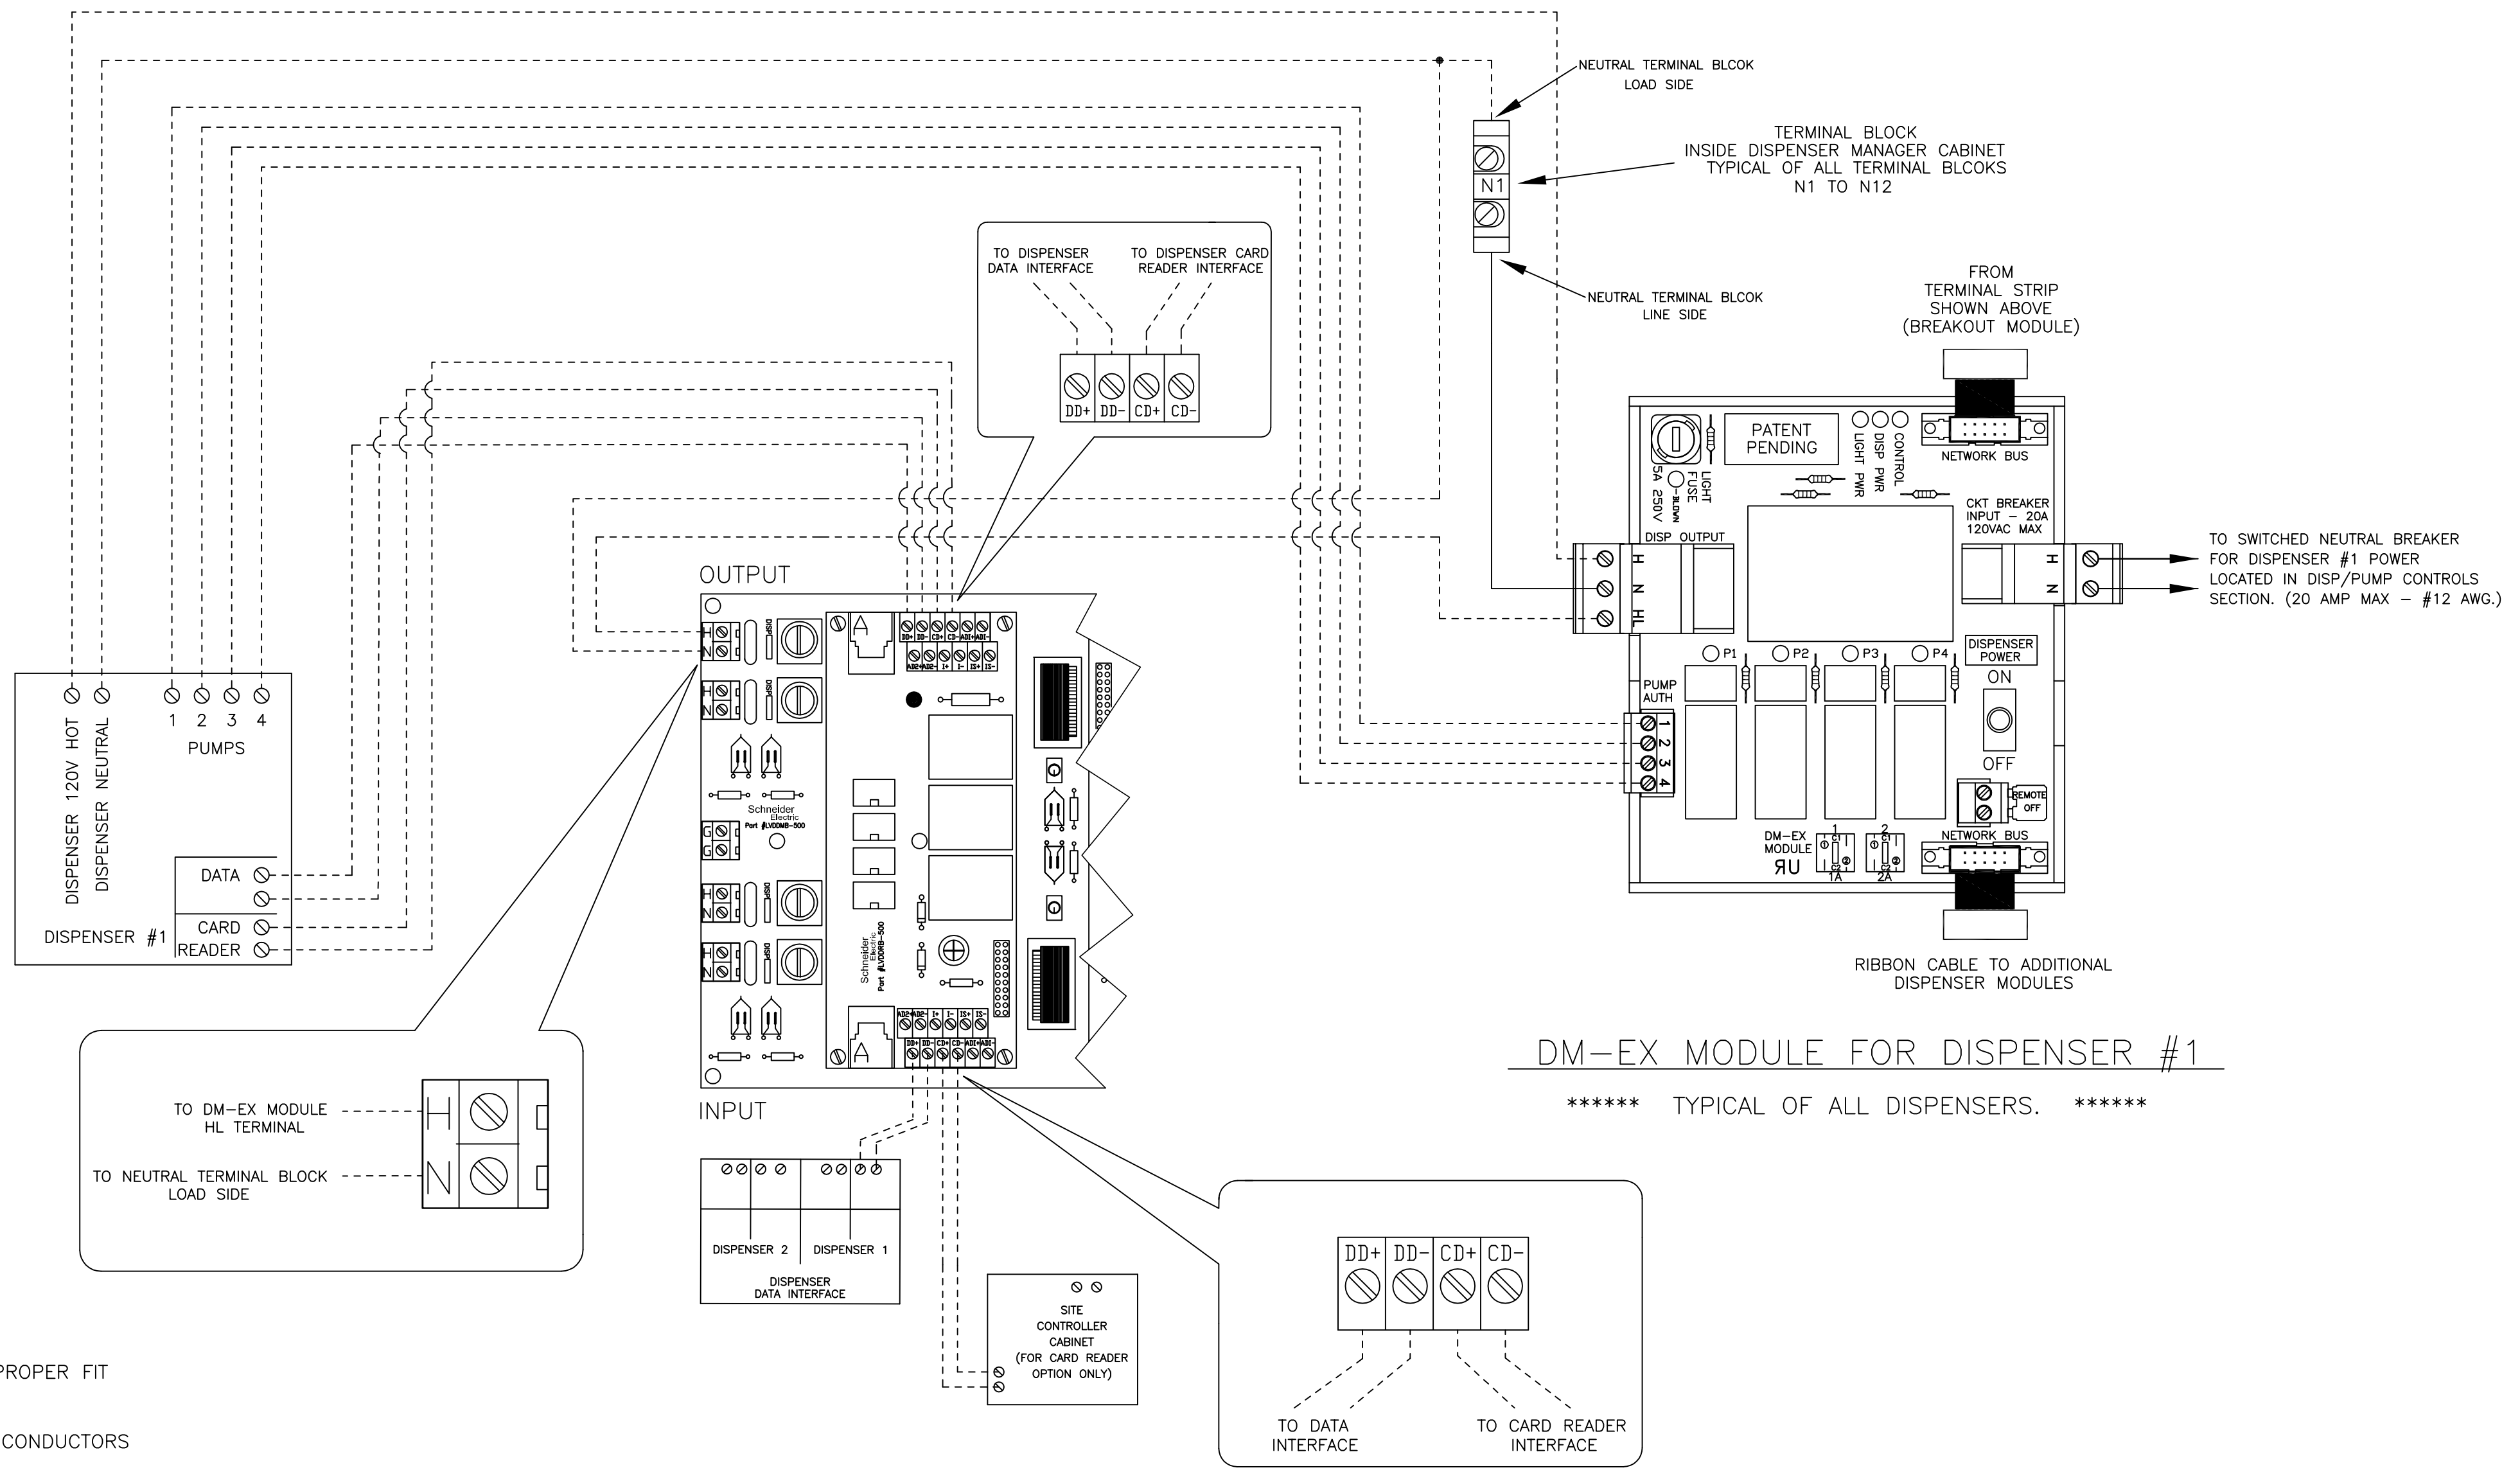

GENERAL NOTES FOR WIRING

- 1. INSTALL ONLY THE SUITABLE CABLE SIZES INSURING A PROPER FIT WITH THE CORRESPONDING CONNECTORS
- 2. PULL THE PROPER SIZE OF LINE SIZE AND LOAD SIDE CONDUCTORS ACCORDING TO THE LOAD SERVED AND THE NEC OR CEC.

WIRING LEGEND	
-----	CONTRACTOR FIELD WIRING
_____	IPaCS FACTORY WIRING

JOB NAME:	C-STORE TYPICAL DISPENSER FIELD WIRING	EQUIPMENT DESIGNATION:	FUEL CONTROL SCREEN
JOB LOCATION:	ANYWHERE, USA	EQUIPMENT TYPE:	ON SITE MANAGER II
DRAWN BY:	XLZ	DRAWING TYPE:	DISPENSER CONTROLS
ENGR:	XLZ		
DATE:	02/01/2013		
DRAWING STATUS:	PRELIMINARY	DWG#	---
		PG 1	OF 1
		REV	-